


**SUPPLEMENTAL DOCUMENT FOR:
Boiler Regulation Advisory – Issued By: The Bureau
of Boiler and Pressure Vessel Compliance on the
Use of a Backflow Preventer in Boiler Applications**

This simplified sketch is provided to assist the qualified boiler installer in the proper installation of the shut-off and check valve mandated by the Bureau of Boiler and Pressure Vessel Compliance. It is provided for clarification purposes only and does not show all possible connections, interfaces or integral piping possible and that may be required by all the jurisdictional authorities. ¹The type of stop valve or cock used is determined by the system designer.

² Regardless of the type of boiler, any other equipment is installed upstream of the arrangement shown in this sketch

Note: ²Any other equipment is installed upstream from the arrangement indicated below.

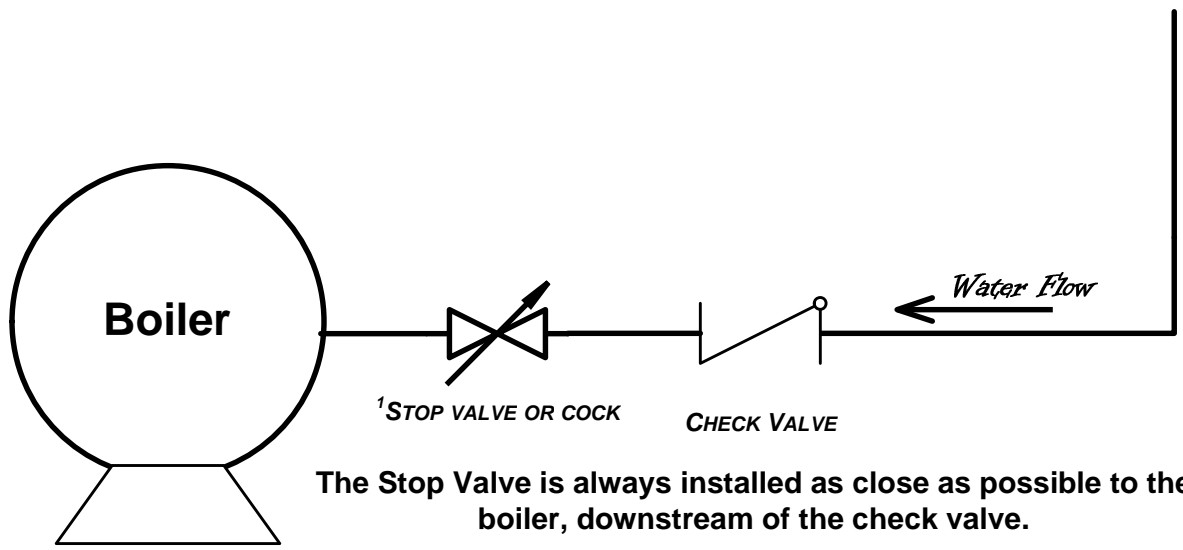

**CONTACT:
BUREAU OF BOILER AND PRESSURE VESSEL COMPLIANCE
P.O. Box 392
TRENTON, NJ 08625-0392**

**VOICE: (609) 292-2345
FAX: (609) 984-1577**